

Monthly Energy Example for A Facility Building

Example: Customer production was 1,000 kWh. 500 kWh was sent to the grid. Customer facility really used 1,500 kWh, but Oncor only saw 1,000 kWh as in-flow.

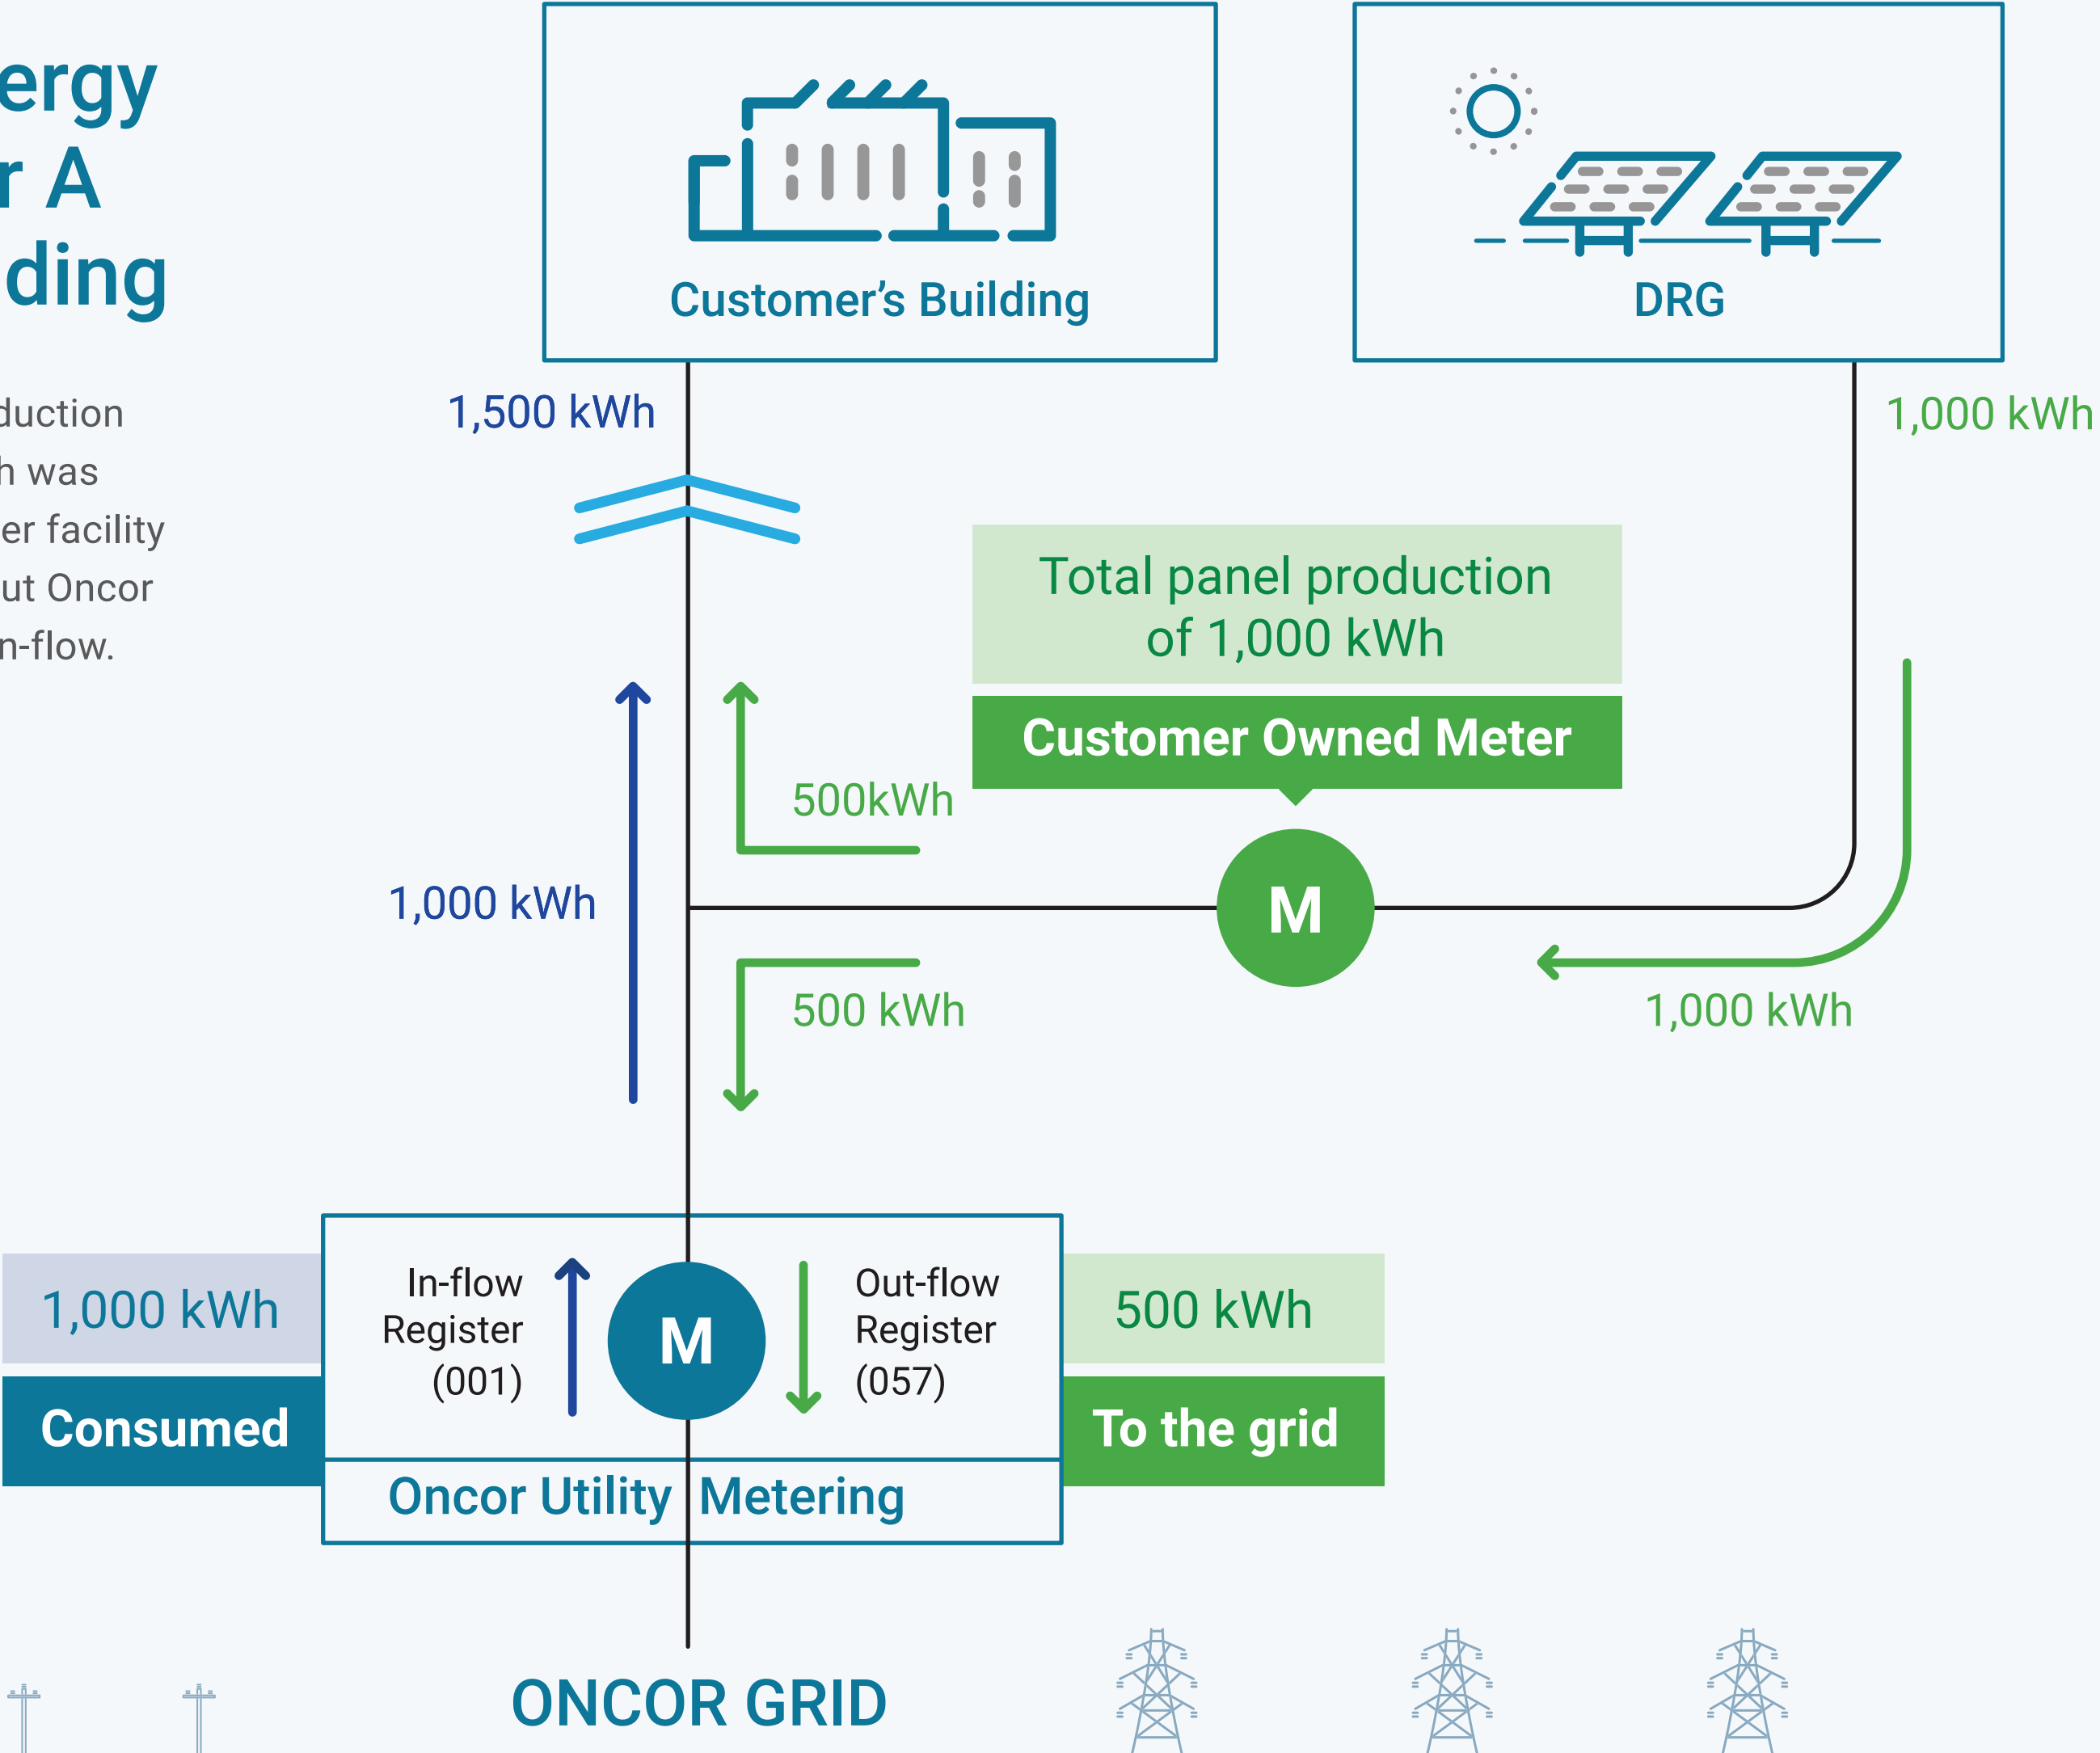


Figure 1 – Customer Metering Versus Oncor Metering

*Approval for operation requires a fully executed Interconnection Agreement and the installation of an in-flow / out-flow meter.